



COMPLIANCE DATA UPDATE 12/23/2019

To ensure continued transparency as we work to restore safe drinking water for all residents in University Park, Aqua Illinois is sharing its sampling results on WaterFactsIL.com regularly to keep the community and other stakeholders informed of our progress.

Before we provide some helpful background, please see the below important information for our customers:

If you remain under the advisory, **you can consume your tap water if you:**

1. **Run your cold tap water for 2 to 3 minutes before use if your water has sat stagnant in internal plumbing AND,**
2. **After running the tap, filter cold tap water through filters certified by the NSF to remove lead, like the faucet and pitcher filters Aqua Illinois continues to provide to customers.**

After filtering the cold tap water, you can always heat it up prior to consumption.

As a reminder, you can use unfiltered tap water (hot or cold) for non-consumption daily uses, such as bathing, washing your hands, washing dishes or doing laundry.

This data update includes:

- Detailed information regarding our sampling program
- An explanation of what we believe happened and how we are working to fix the situation
- A message from the Illinois Environmental Protection Agency
- The latest sampling results, including an explanation of the data

Explaining compliance samples

The EPA, through its lead and copper rule, requires water utilities to work with their customers to collect regularly scheduled stagnation samples, or compliance samples. This rule is designed to gather samples of water that has remained in customers' pipes for six or more hours. Water that sits in pipes unused for six or more hours provides high-case scenario data for lead exposure. The EPA deems water treatment effective when test results are less than 15 micrograms per liter (ug/L) across 90 percent of sample locations. Utilities must choose locations to sample to represent properties with the highest inventory of lead. For example, Tier 1 locations include those with lead service lines or lead solder on copper pipes on homes constructed after 1982. The lead and copper rule does not set a health-based lead limit. It is a treatment-based rule. That means if 90 percent of compliance samples are less than 15 ug/L, treatment is deemed effective, and any samples over 15 ug/L are analyzed on an individual basis.

To complete compliance sampling, we provide bottles and instructions to participating customers, who then collect the samples. We pick up the sample bottles when customers confirm the samples are ready, and then we send them to an independent lab for testing.



Water compliance sampling

IEPA regulations require Aqua Illinois to work with at least 40 homes and businesses in the University Park service area to conduct water compliance sampling. These locations must be submitted to the IEPA before compliance sampling can begin.

We collected regularly scheduled samples in May 2019 as part of our biannual compliance testing schedule. On June 13, 2019, we began receiving those sampling results, some of which showed elevated lead levels. As a result, we began working with the IEPA on a treatment plan and voluntarily increased the testing frequency, which now includes conducting biweekly compliance sampling, to help us understand and monitor progress as we resolve this issue.

We are committed to being fully transparent and will share our results at WaterFactsIL.com.

What occurred and how we are fixing it

We immediately issued a voluntary do-not-consume advisory on June 14, 2019 for all customers in the service area to be as protective as possible after receiving compliance samples that showed elevated lead levels in 14 homes on June 13, 2019. Thereafter, we investigated and gathered information about this situation. It is important to note that no state or federal regulation required us to issue the do-not-consume advisory and that we issued it as a precaution to protect the public until we learned more about the extent, cause and level of the issue AND until we could implement alternative protective health measures. We have since transitioned to a lead advisory to provide more useful guidance to customers. We are continuing our public education efforts, so impacted customers know the protective steps to take to consume their water.

We have identified that the likely cause of elevated lead levels is due to water chemistry interacting with lead solder in customers' internal plumbing. Our information shows that the water in Aqua Illinois' distribution system and infrastructure does not have elevated levels of lead.

The EPA banned lead solder in 1986, and compliance testing results in post-1990 homes have shown lead levels meet the EPA action level. We have since removed some areas from the advisory based on property age and water sample results. While not required, we still recommend customers whose properties have been lifted from the advisory run their tap water for two to three minutes and until they notice a temperature change before consumption. This ensures they receive fresh water from the mains in the street rather than water that has been sitting stagnant in their internal plumbing.

On June 15, 2019, Aqua Illinois introduced a new treatment, orthophosphate (or, more specifically, a 90/10 phosphate blend), into the water system in the entire service area. This treatment is known for its ability to create a protective coating where lead is present, keeping it out of the water we consume. The treatment can take months to become effective. This treatment is not harmful to humans or pets.

Please visit WaterFactsIL.com or call 877.987.2782 for the most up-to-date information.



A Message from the IEPA

The Centers for Disease Control and Prevention indicates there is no safe blood lead level in children. Lead exposures come from a combination of environmental sources, which may include lead in water. U.S. EPA estimates that water can make up 20 percent or more of a person's total exposure to lead, and infants who consume mostly mixed formula can receive 40-60 percent of their exposure to lead from drinking water. The source of lead in water is most often from a building's plumbing system.

The IEPA and Illinois Department of Public Health support point-of-use (POU) filters as a short-term strategy for reducing lead in drinking water. (Please note: Aqua Illinois is providing free faucet filters and pitcher filters to customers in University Park). A POU system filters water at the point where water is being used and is installed at the water connection, typically under the sink in the kitchen or bathroom. Water pitchers with POU filters may also be used. POU filters are commercially available and can be effective at removing most lead. There are several POU cartridge filter units on the market. They can vary in price and effectiveness. Filters should routinely be replaced or maintained in accordance with manufacturers guidelines and recommendations to remain effective.

To select a lead-reducing POU filter, check with the manufacturer or a third-party website (such as www.nsf.org) to verify the product was tested and certified for lead removal (NSF/ANSI Standard 53). For additional protection for particulate lead, look for a POU filter that is also certified against NSF/ANSI Standard 42 (for class I particulate reduction, 0.5 micrometers to less than 1 micrometers). To be effective, the POU filters should be installed at locations used for drinking water or for food preparation according to the manufacturer's instructions. This includes kitchen water faucets and refrigerators with water dispensers and ice makers or in water pitchers.

POU filters should be considered an interim measure until [effective treatment is restored, or] the sources of lead have been removed and replaced with lead free plumbing materials. After replacement of lead plumbing materials or disturbance of a plumbing system, the plumbing system should be flushed for 30 minutes with aerators and screens removed from all faucets. Because you cannot see, smell, or taste lead in water, testing the water is the only way to determine if lead is present in drinking water.

To access additional information about lead in drinking water and a consumer tool for identifying POU filters certified to reduce lead, please visit U.S. EPA's website at <https://www.epa.gov/ground-water-and-drinking-water/basic-information-about-lead-drinking-water> and <https://www.epa.gov/water-research/consumer-tool-identifying-pou-drinking-water-filters-certified-reduce-lead>.

Lead in homes can also come from sources other than water. To access more information about other sources of lead, please visit IDPH's website at: <http://www.dph.illinois.gov/illinoislead>. Consider contacting your doctor to have your children tested if you are concerned about lead exposure.



Understanding the results

The Dec. 23, 2019 biweekly data update measures the change in lead levels in water and includes 16 sample groups as of Dec. 18, 2019 and reflects 185 days with the current treatment in place. The information is shown in a graph (Figure 1) and in a data table (Table 1).

Please note that the specific number of sites listed may differ in each sample group because we receive customer samples and results from the independent labs on different days.

It is important to know that although we cannot predict an exact timeline, it will likely take several months, in total, for the new treatment to establish coating inside the pipes of homes with lead plumbing. The more customers use their water, the more exposure their plumbing will have to the new water chemistry, which will help restore the protective coating on the pipes.

Highlights of latest findings

- 68 percent of samples were at or below 15 ug/L (up from 40 percent in Sample Group 5 on July 12, 2019)
- The median concentration is 2.4 ug/L
- Lead concentrations continue to show some variability. This fluctuation is to be expected as the piping continues to adjust to the treatment.
- Water use helps reduce lead concentrations by bringing the chemical treatment into contact with the home plumbing and flushing out old lead particles.

Explanation of latest findings

In Sample Group 16, 68 percent of samples were at or below 15 ug/L. The median concentration of 2.4 ug/L remained below 5 ug/L. The median concentration remains similar to those observed in Sample Groups 12 through 15. The data show that lead levels have significantly decreased since Sample Group 5 (July 12, 2019), which corroborates that the treatment is working. It is important that customers continue using their water for the new treatment to be effective.



Phase 1 and Phase 2 sampling explained

Sample Groups 1 through 3 included some homes built after 1990, or homes unlikely to have lead solder in internal plumbing, and these sample groups represent “Phase 1” of our water testing. Through our investigation, we believe that the source of elevated lead levels is from lead solder in homes built before 1990. Based on this information, we have coordinated with the IEPA to establish revised testing criteria to only include pre-1990 homes with lead solder in internal plumbing. We have also added more pre-1990 homes to our compliance sampling pool to advance our efforts to resolve the situation. The new sampling criteria, beginning with Sample Group 4, represent “Phase 2” for the IEPA-approved water testing criteria.

Because Phase 2 includes only pre-1990 homes with lead solder, these sample results are not directly comparable to those in Phase 1. This second phase of sampling criteria enables us to conduct more targeted sampling based on the properties most likely to be impacted.

Phase 2 represents the most recent, and therefore most important, results and these will be presented first. The results for Phase 1 are still included later in this document for completeness.



Phase 2 sampling results for lead in University Park


Sampling results below include samples collected by customers at an expanded number of sample locations, compared with Phase 1 testing. We have increased the number of locations, thanks to the cooperation of our customers, from approximately 40 to more than 80 homes and businesses in the University Park area. As part of our investigation, we removed post-1990 homes and added more pre-1990 sampling locations to the existing sample set. This ensures that our lead testing represents the various property types, ages, and plumbing construction in the community.

Samples are to be collected by customers after the water sat in plumbing pipes for more than six hours to represent a high-case scenario. The information is shown in a graph (Figure 1) and in a data table (Table 1).

The EPA standard states that 90 percent of the sample results should be below a lead concentration of 15 micrograms per liter (ug/L) in drinking water.



Figure 1 - Phase 2 IEPA Compliance Samples Including Only Pre-1990 Homes with Lead Solder in Internal Plumbing: Sample Groups 4 – 16

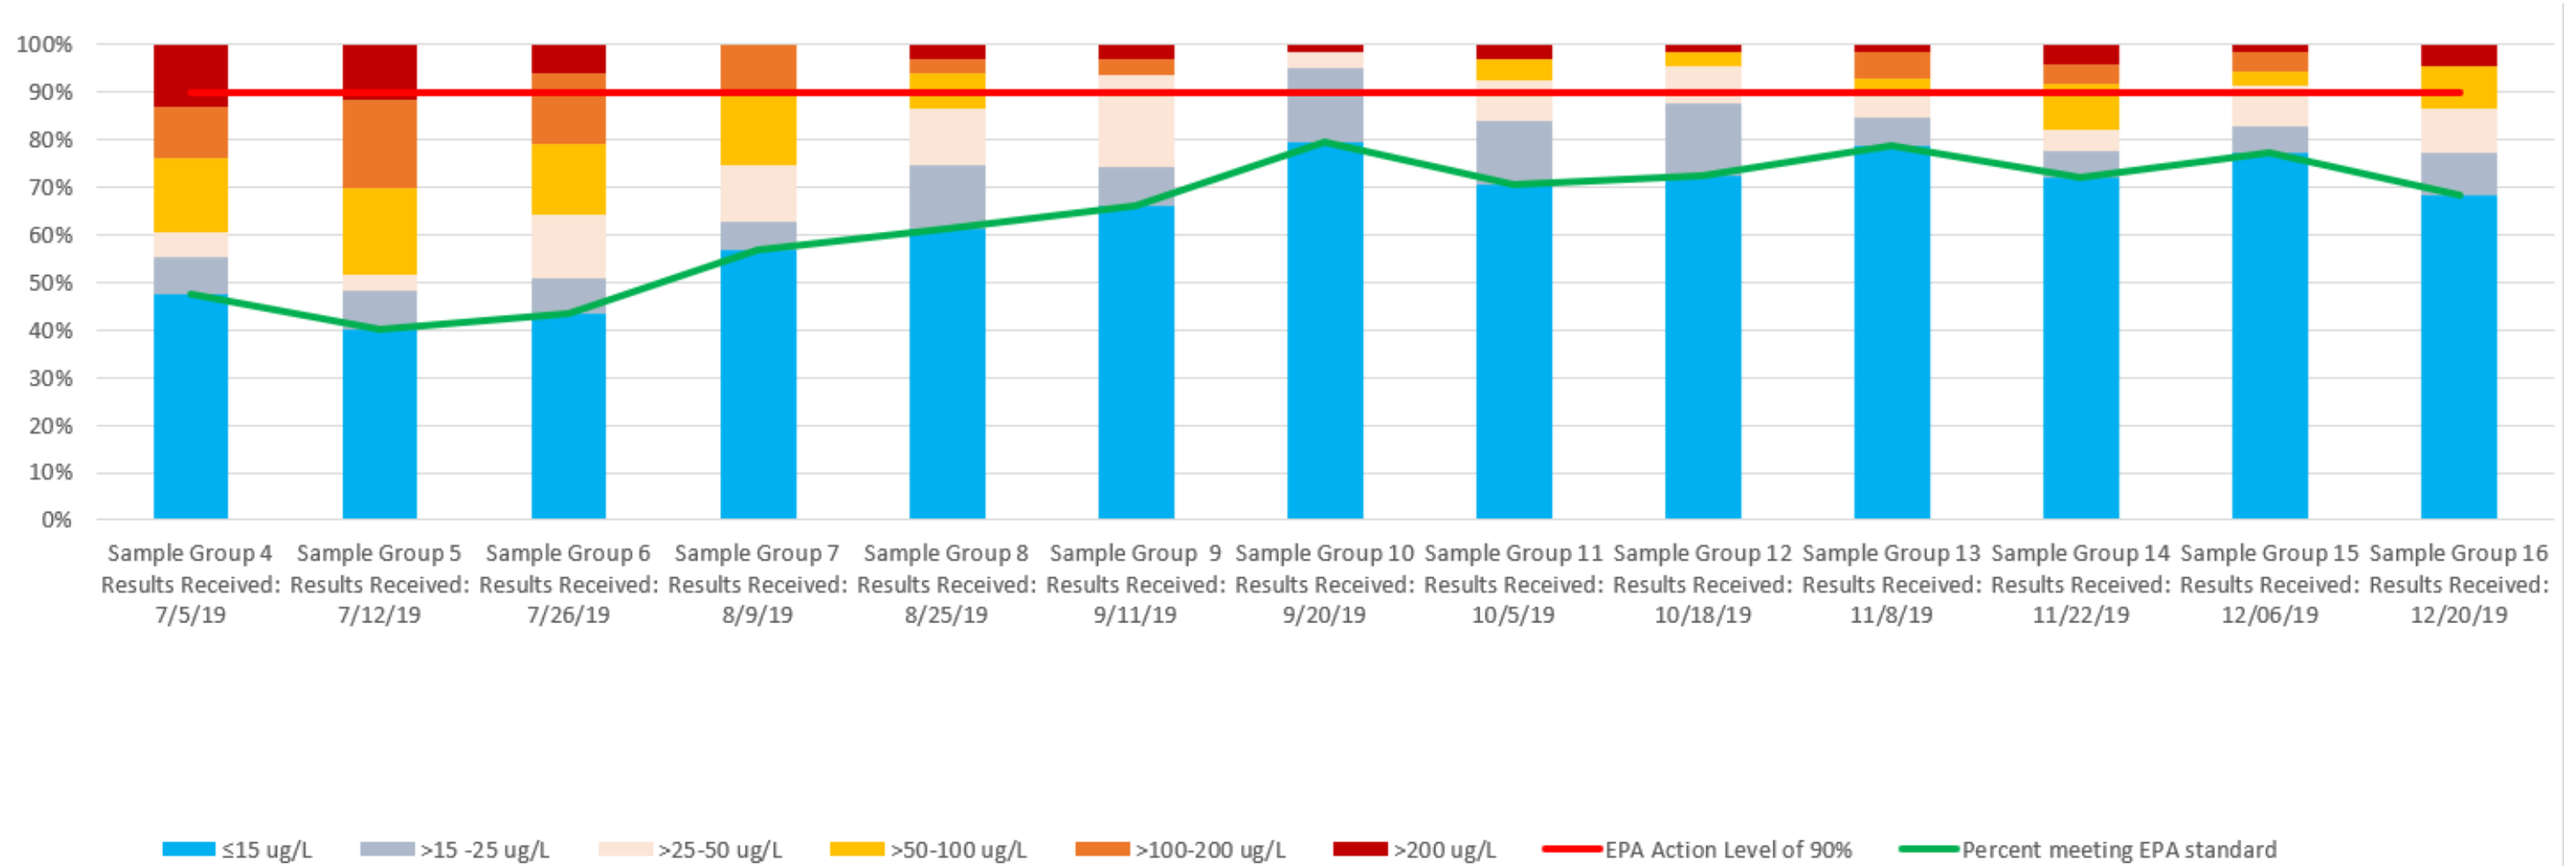

*Note: Sample Group 5 includes 15 additional pre-1990 homes beyond those included in Sample Group 4. These sample groups are not directly comparable.



Table 1 – Phase 2 IEPA Compliance Samples including Only Pre-1990 Homes with Lead Solder in Internal Plumbing: Sample Groups 4 – 16

Home ID	Year Built	Sample Group 4 Results Received: 7/5/19	Sample Group 5 Results Received: 7/12/19	Sample Group 6 Results Received: 7/26/19	Sample Group 7 Results Received: 8/9/19	Sample Group 8 Results Received: 8/23/19	Sample Group 9 Results Received: 9/11/19	Sample Group 10 Results Received: 9/20/19	Sample Group 11 Results Received: 10/5/19	Sample Group 12 Results Received: 10/18/19	Sample Group 13 Results Received: 11/08/19	Sample Group 14 Results Received: 11/22/19	Sample Group 15 Results Received: 12/06/19	Sample Group 16 Results Received: 12/20/19
1	1970	130	370	120	200	5.2	*	*	*	*	*	*	*	*
2	1970	*	*	*	*	*	*	*	*	*	*	*	*	*
3	1970	<1.0	13	1.2	6.5	*	*	*	*	*	*	*	<1.0	*
4	1970	<1.0	<1.0	3	1	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
5	1970	*	<1.0	<1.0	<1.0	*	*	*	<1.0	*	<1.0	<1.0	<1.0	<1.0
6	1970	<1.0	180	<1.0	25	<1.0	<1.0	*	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
7	1970	130	77	39	34	3.2	2.1	<1.0	1.1	2.9	<1.0	<1.0	3.0	<1.0
8	1970	3.4	7.5	2.3	<1.0	3.4	7.3	<1.0	2.6	8.2	<1.0	1.5	<1.0	<1.0
9	1970	<1.0	*	*	<1.0	<1.0	*	<1.0	<1.0	*	<1.0	<1.0	<1.0	<1.0
10	1970	19	120	54	*	13	13	<1.0	15	17	5.8	8.8	20	27
11	1972	<1.0	1.5	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
12	1972	<1.0	1.5	<1.0	<1.0	<1.0	*	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
13	1973	18	76	120	24	5	3.6	2.1	5.3	4.3	3.0	1.8	5.7	<1.0
14	1973	55	63	22	19	10	1.6	1.4	<1.0	<1.0	1.4	<1.0	<1.0	<1.0
15	1973	8	12	<1.0	9.6	1.1	2.3	*	<1.0	<1.0	1.3	<1.0	2.2	5.7
16	1973	150	3900	800	180	83	110	33	36	22	6.7	<1.0	2.2	2.6
17	1973	83	89	74	44	22	34	23	12	2.3	1.4	2.6	29	53
18	1970	**	**	**	**	**	**	**	**	**	**	**	**	**
19	1974	40	100	120	54	21	*	8.4	*	6	120	28	*	*
20	1974	52	55	31	19	34	26	25	21	5.9	6.9	5.9	9.1	20
21	1975	220	230	89	40	53	*	25	47	25	22	77	52	23
22	1975	**	**	**	**	**	**	**	**	**	**	**	**	**
23	1975	66	110	60	35	26	20	11	25	8.1	15	59	24	51
24	1975	**	**	**	**	**	**	**	**	**	**	**	**	**
25	1975	1.2	5.3	14	1	9.3	1.5	<1.0	<1.0	1.1	3.1	5.2	<1.0	*
26	1975	*	*	*	*	<1.0	*	*	*	*	*	<1.0	*	*
27	1975	*	110	120	37	29	32	2.6	32	<1.0	48	21	5.5	12
28	1975	5.4	200	85	200	85	180	20	79	37	34	14	2.5	6.4
29	1975	52	84	87	44	16	8.9	17	18	18	13	25	15	24
30	1975	*	*	23	<1.0	<1.0	<1.0	2.8	<1.0	<1.0	<1.0	<1.0	<1.0	1.8



Home ID	Year Built	Sample Group 4 Results Received: 7/5/19	Sample Group 5 Results Received: 7/12/19	Sample Group 6 Results Received: 7/26/19	Sample Group 7 Results Received: 8/9/19	Sample Group 8 Results Received: 8/23/19	Sample Group 9 Results Received: 9/11/19	Sample Group 10 Results Received: 9/20/19	Sample Group 11 Results Received: 10/5/19	Sample Group 12 Results Received: 10/18/19	Sample Group 13 Results Received: 11/08/19	Sample Group 14 Results Received: 11/22/19	Sample Group 15 Results Received: 12/06/19	Sample Group 16 Results Received: 12/20/19
31	1975	7.2	18	17	5.2	4.5	<1.0	<1.0	<1.0	1.1	5.3	3.7	1.4	<1.0
32	1975	22	81	7.3	<1.0	<1.0	<1.0	25	24	13	18	12	7.1	26
33	1975	480	860	3100	160	430	380	740	86	49	130	7.5	25	720
34	1979	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
35	1990	**	**	**	**	**	**	**	**	**	**	**	**	**
36	1996	**	**	**	**	**	**	**	**	**	**	**	**	**
37	1998	**	**	**	**	**	**	**	**	**	**	**	**	**
38	2002	**	**	**	**	**	**	**	**	**	**	**	**	**
39	2006	**	**	**	**	**	**	**	**	**	**	**	**	**
40	2008	**	**	**	**	**	**	**	**	**	**	**	**	**
41	2007	**	**	**	**	**	**	**	**	**	**	**	**	**
42	1970	<1.0	<1.0	*	1.9	<1.0	*	*	<1.0	*	<1.0	*	*	*
43	1975	3.3	7.3	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	2.2	<1.0
44	1975	170	140	110	87	49	46	<1.0	7.5	19	19	70	8.5	30
45	NA	240	140	46	78	41	9.4	13	240	50	1.9	20	470	4.6
46	1975	<1.0	<1.0	*	<1.0	*	*	*	*	<1.0	*	*	*	*
47	1973	<1.0	3.7	1.1	*	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
48	1975	5.2	5	1.4	1.1	<1.0	1.5	<1.0	<1.0	<1.0	1.7	<1.0	<1.0	<1.0
49	1970	**	**	**	**	**	**	**	**	**	**	*	*	*
50	1972	350	1800	150	51	9.2	4.5	3.6	2.9	3.6	1.4	2.4	<1.0	<1.0
51	1973	35	1.6	6	1.5	<1.0	3.5	<1.0	6.7	8.5	<1.0	<1.0	<1.0	1.2
52	1974	**	**	**	**	**	**	**	**	**	**	**	**	**
53	1976	440	140	130	100	76	11	13	7.1	3.9	6.0	8.2	3.7	1.4
54	1975	***	7.1	460	1.4	*	34	1.6	28	5	*	4.9	1.7	4.0
55	1975	***	24	14	170	160	210	42	81	18	120	100	110	5300
56	1975	***	110	<1.0	1.3	18	21	21	9.9	1.1	5.1	2.5	<1.0	1.4
57	1975	***	55	110	60	31	27	11	17	10	5.5	110	29	*
58	1979	***	2	4.7	65	25	43	14	18	7	45	13	1.4	20
59	1950	**	**	**	**	**	**	**	**	**	**	**	**	**
60	1975	***	2.3	48	2	<1.0	<1.0	<1.0	<1.0	1.4	<1.0	<1.0	1.2	2.3
61	1972	***	210	190	54	*	17	15	15	54	23	54	*	*
62	1970	***	<1.0	<1.0	<1.0	5.9	<1.0	<1.0	*	<1.0	<1.0	<1.0	<1.0	<1.0
63	1975	***	41	16	61	10	24	4.3	8.5	14	9.0	260	4.4	1.7



Home ID	Year Built	Sample Group 4 Results Received: 7/5/19	Sample Group 5 Results Received: 7/12/19	Sample Group 6 Results Received: 7/26/19	Sample Group 7 Results Received: 8/9/19	Sample Group 8 Results Received: 8/23/19	Sample Group 9 Results Received: 9/11/19	Sample Group 10 Results Received: 9/20/19	Sample Group 11 Results Received: 10/5/19	Sample Group 12 Results Received: 10/18/19	Sample Group 13 Results Received: 11/08/19	Sample Group 14 Results Received: 11/22/19	Sample Group 15 Results Received: 12/06/19	Sample Group 16 Results Received: 12/20/19
64	1975	***	12	37	9.6	6.3	4.9	6.2	3.8	*	<1.0	140	140	2.4
65	1975	***	1.5	*	15	8	1.9	<1.0	<1.0	<1.0	<1.0	1.5	<1.0	<1.0
66	1970	***	1.4	2.6	*	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
67	1965	***	9.5	170	<1.0	21	3.7	22	2.9	1.4	*	<1.0	2.2	*
68	1972	***	85	5.1	*	*	*	<1.0	1.3	20	1.9	8.2	1.7	2.0
69	1970	***	190	84	7.7	<1.0	<1.0	<1.0	<1.0	1.5	<1.0	9.1	1.7	<1.0
70	1970	***	130	60	180	31	23	21	22	47	85	58	34	44
71	1975	***	55	27	43	6.6	12	22	3.8	3.7	34	25	30	50
72	1975	***	460	220	130	200	43	15	1300	22	*	*	68	85
73	1975	***	34	32	14	13	8.6	11	*	5.5	5.8	270	5.7	2.3
74	1970	***	<1.0	<1.0	4.7	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
75	1973	***	16	12	9.2	6	1.9	<1.0	1.2	23	1.7	5.3	4.2	4.9
76	1984	***	22	*	*	*	*	2.4	14	*	7.7	*	*	6.4
77	1983	***	18	6.9	3.6	16	13	7.8	6.8	35	6.2	4.1	7.6	18
78	1970	***	***	3.9	2.9	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
79	NA	***	***	44	<1.0	<1.0	38	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
80	1975	***	***	2.4	*	4.7	*	*	*	<1.0	<1.0	36	6.3	62
81	1970	***	***	43	30	18	3.7	1.1	3.3	3.4	2.4	9.5	2.8	56
82	1970	***	***	77	6.4	4.2	<1.0	1.2	1.4	1.9	<1.0	8.2	2.3	15
83	1970	***	***	14	**	**	**	**	**	**	**	**	**	**
84	1973	***	***	4.7	2.8	*	1.2	*	2.1	*	1.6	1.8	1.5	<1.0
85	1973	***	***	86	14	70	27	10	31	14	1.5	13	25	22
86	1975	***	***	<1.0	<1.0	*	*	*	45	11	3.2	6.8	7.6	69
87	1975	***	***	23	61	22	38	13	5.6	19	2.0	45.0	3.9	9.1
88	1983	***	***	***	<1.0	*	<1.0	*	*	*	*	*	*	*
89	1970	***	***	***	***	1.1	*	8.3	1.4	*	7.1	3.7	1.1	12
90	1975	***	***	***	***	29	15	4.1	16	84	2.4	58	45	210
91	1975	***	***	***	***	210	30	*	*	*	56	150	110	*
92	NA	***	***	***	***	***	***	*	19	520	160	360	50	38
93	NA	*	*	*	*	*	*	*	*	*	*	*	*	*
94	1975	*	*	*	*	*	*	*	*	*	<1.0	<1.0	<1.0	<1.0
95	1975	*	*	*	*	*	*	*	*	*	430	*	*	*



*Property/Home ID did not return sample ** Property/Home ID removed from compliance sampling pool *** Property/Home ID not yet added to sampling pool

Concentration Statistics (ug/L)	Parameter	Sample Group 4 Results Received: 7/5/19	Sample Group 5 Results Received: 7/12/19	Sample Group 6 Results Received: 7/26/19	Sample Group 7 Results Received: 8/9/19	Sample Group 8 Results Received: 8/25/19	Sample Group 9 Results Received: 9/11/19	Sample Group 10 Results Received: 9/20/19	Sample Group 11 Results Received: 10/5/19	Sample Group 12 Results Received: 10/18/19	Sample Group 13 Results Received: 11/08/19	Sample Group 14 Results Received: 11/22/19	Sample Group 15 Results Received: 12/06/19	Sample Group 16 Results Received: 12/20/19
		minimum	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
maximum	480	3900	3100	200	430	380	740	1300	520	430	360	470	5300	
median	18.5	37.5	23.0	9.6	6.6	4.9	2.8	3.6	3.9	1.9	4.5	2.2	2.4	
average	77.7	175	108	36.2	32.3	25.1	19.8	34.6	19.2	21.2	30	20.1	107	
90th percentile	228	210	136	109	72	42	23	37.8	36	47.7	75.6	45.0	54.2	

*Note: Concentration statistics for a given sample group may change if we receive additional sampling results after the data have been posted. This means concentration statistics for a given sample group may look different in this biweekly data update compared with previous ones.




Phase 1 sampling results for lead in University Park

Sampling results below are provided from samples collected by customers at approximately 40 homes and businesses in the University Park area. Samples are collected after the water sat in plumbing pipes for more than six hours to represent a high-case scenario. The information is shown in a graph (Figure 2) and in a data table (Table 2).

The EPA standard states that 90 percent of the sample results should be below a lead concentration of 15 micrograms per liter (ug/L) in drinking water.



Figure 2 – Phase 1 IEPA Compliance Samples including Post-1990 Homes: Sample Groups 1 – 3

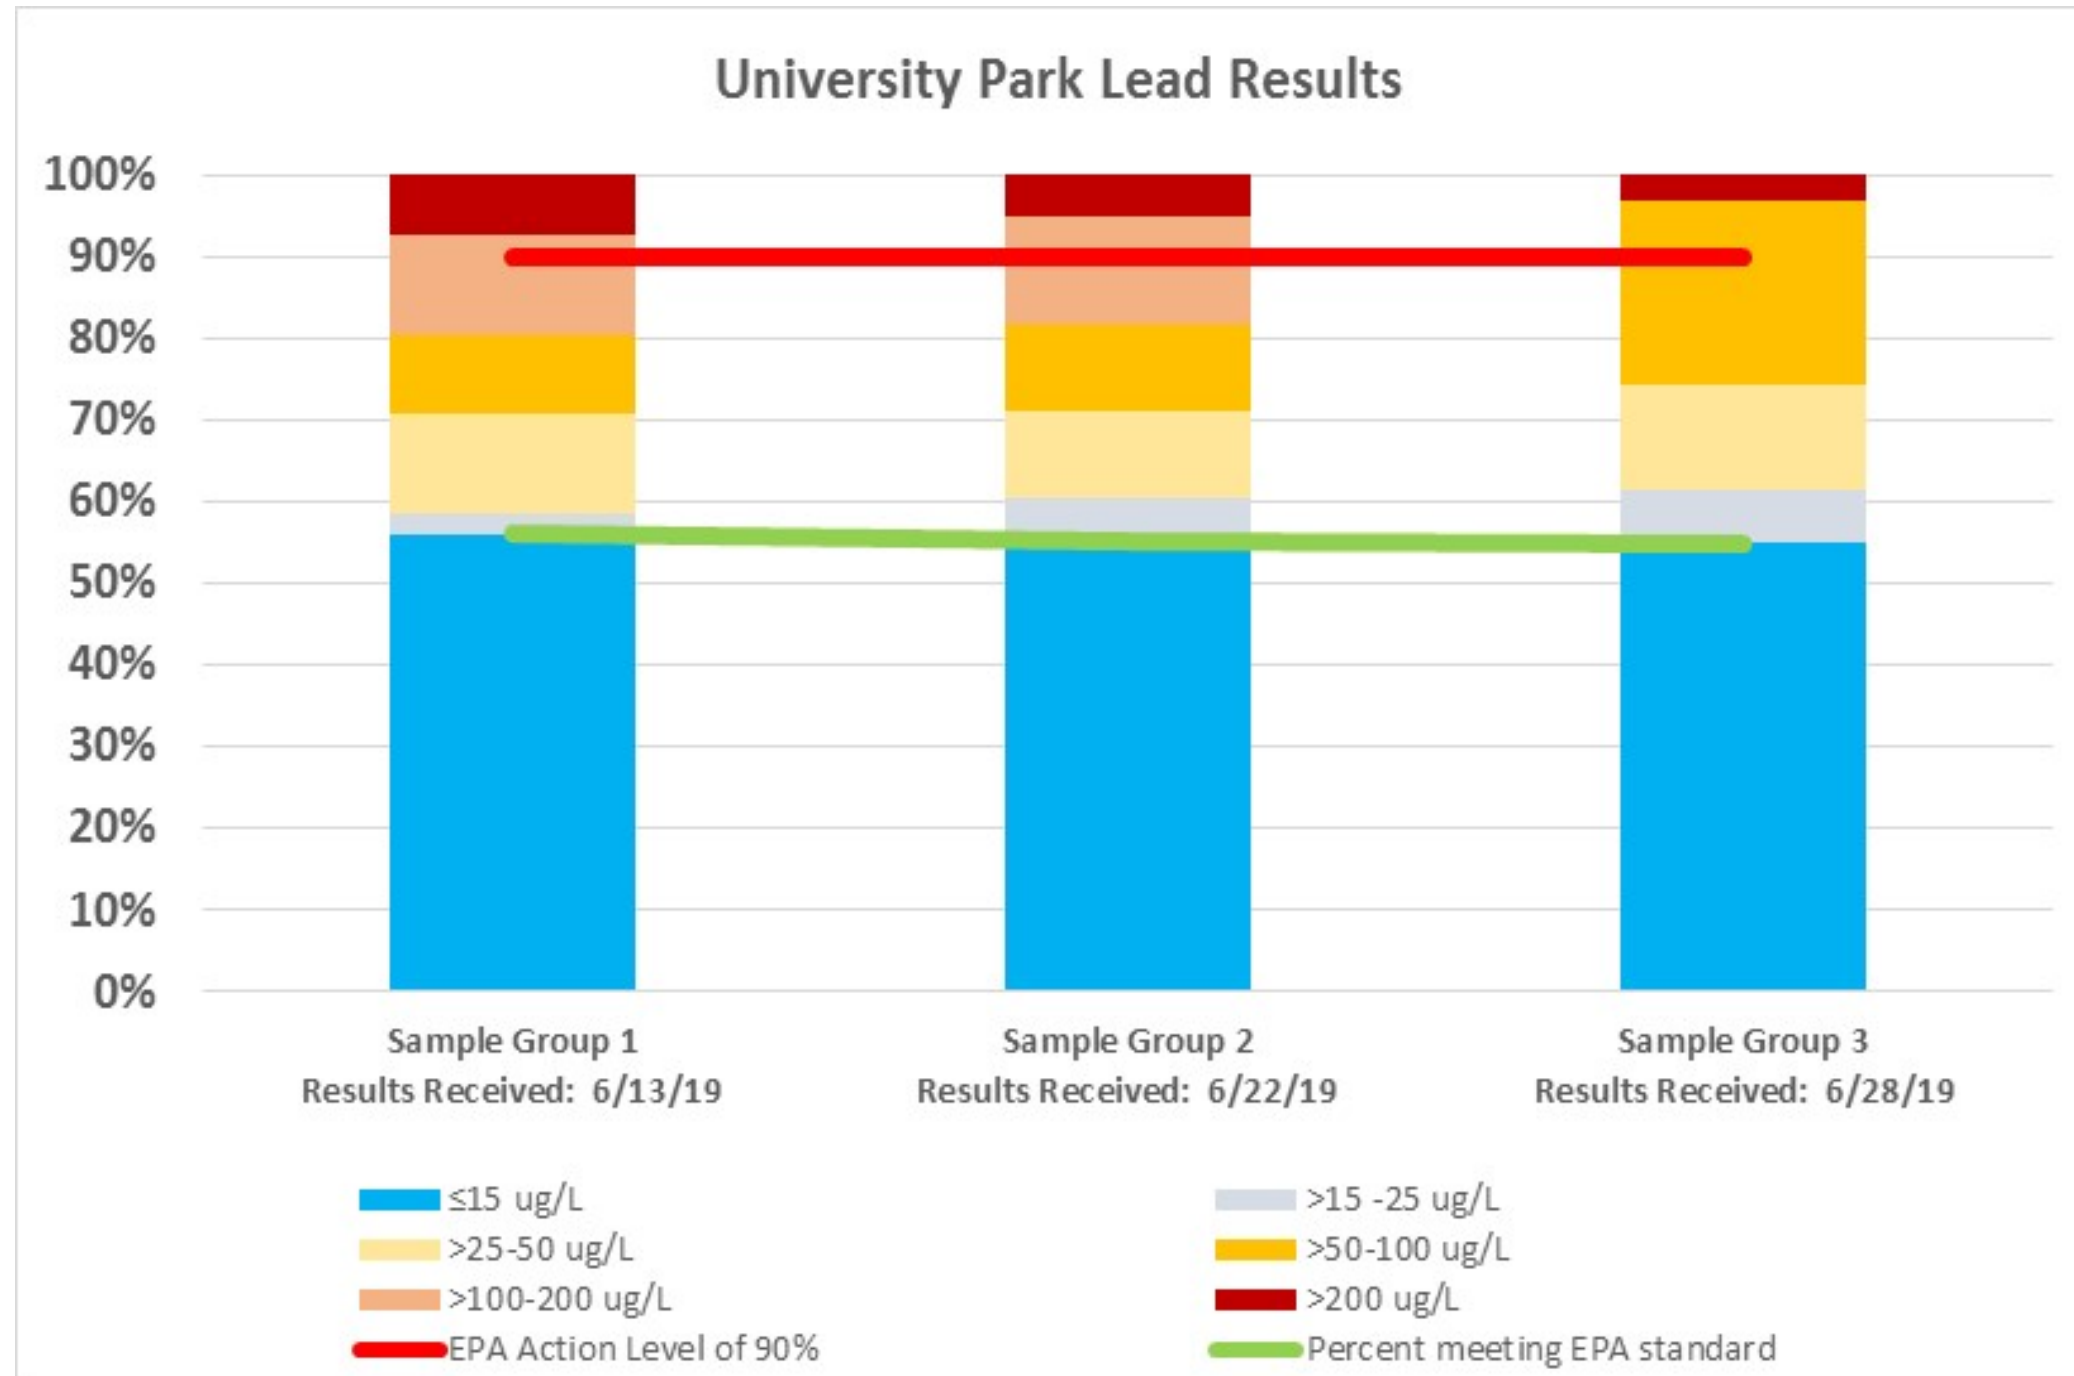



Phase 1 lead sampling results for University Park - Sample Groups 1 – 3

The table below represents lead sampling results from Sample Group 1 collected in May 2019 as part of our biannual required sampling, and subsequent Sample Groups 2 and 3. We were conducting weekly testing during this time period. Please note, not all results may be available in the table below for each sample group, because we may receive samples back from customers or results from the lab on different days. The table will be updated to include results as they become available. To maintain privacy of individual owners, we have identified each sample with a Home ID rather than actual street address.



Table 2 –Phase 1 IEPA Compliance Samples including Post-1990 Homes: Sample Groups 1 – 3

Home ID	Year Built	Lead Concentration (ug/L)		
		Sample Group 1 Results Received: 6/13/19	Sample Group 2 Results Received: 6/22/19	Sample Group 3 Results Received: 6/28/19
1	1970	110	150	41
2	1970	<1.0	*	*
3	1970	1.3	1.3	2.4
4	1970	<1.0	4.1	1.3
5	1970	1.3	<1.0	<1.0
6	1970	<1.0	<1.0	<1.0
7	1970	66	620	79
8	1970	14	2.5	2.4
9	1970	<1.0	<1.0	*
10	1970	92	480	59
11	1972	<1.0	1.4	<1.0
12	1972	<1.0	<1.0	*
13	1973	23	19	9.8
14	1973	31	38	*
15	1973	3.5	5.1	17
16	1973	670	140	240
17	1973	170	25	45
18	1970	140	160	63
19	1974	280	130	15
20	1974	88	35	24
21	1975	110	62	43
22	1975	2.8	40	*
23	NA	46	42	52
24	1975	180	130	100
25	1975	7.9	<1.0	*
26	1975	6.2	<1.0	*
27	1975	66	44	*
28	1975	41	3.2	83
29	1975	29	51	<1.0
30	1975	1	<1.0	<1.0
31	1975	9.7	9.2	5.2



Home ID	Year Built	Lead Concentration (ug/L)		
		Sample Group 1 Results Received: 6/13/19	Sample Group 2 Results Received: 6/22/19	Sample Group 3 Results Received: 6/28/19
32	1975	35	54	41
33	1975	1700	77	*
34	1979	1.9	<1.0	<1.0
35	1990	<1.0	1.3	1.6
36	1996	<1.0	<1.0	<1.0
37	1998	1.7	<1.0	*
38	2002	<1.0	<1.0	<1.0
39	2006	<1.0	*	<1.0
40	2008	<1.0	<1.0	*
41	2007	<1.0	1.1	<1.0
42	1970	*	*	91

*Property did not return sample

Concentration Statistics (ug/L)	Parameter	Sample Group 1 Results Received: 6/13/19	Sample Group 2 Results Received: 6/22/19	Sample Group 3 Results Received: 6/28/19
	minimum	<1.0	<1.0	<1.0
	maximum	1700	620	240
	median	7.9	5.1	9.8
	average	96.1	60.0	33.1